


WATER METER

PLAN

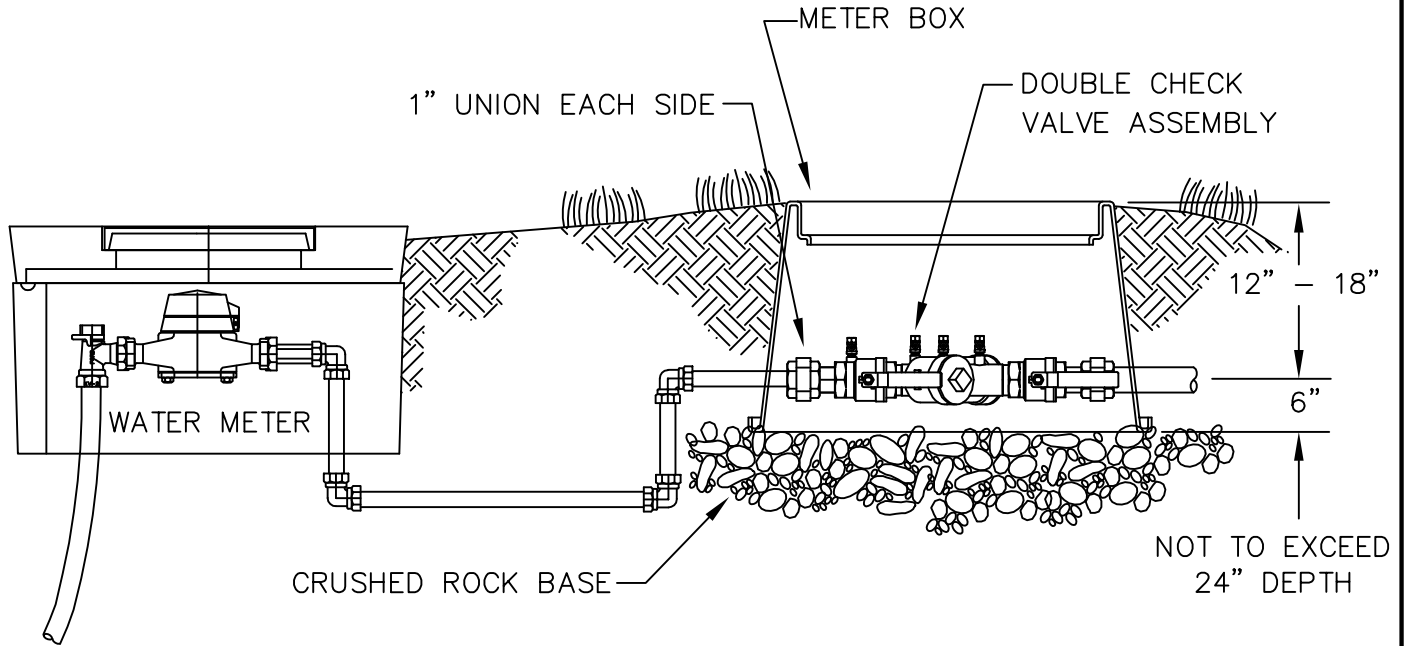

ELEVATION

BOX SPECIFICATIONS	
DEVICE SIZE	BOX TYPE
3/4" - 1"	BROOKS #1419 SERIES OR EQUAL
1 1/2" - 2"	CARSON 1730D P15L OR EQUAL

INSTALLATION SHOWN IS ONLY A SUGGESTION.

1. DOUBLE CHECK TO BE LOCATED DIRECTLY BEHIND WATER METER.
2. BRASS, STAINLESS, OR PLASTIC PLUGS TO BE INSTALLED IN TEST COCKS IF BELOW GROUND INSTALLATION.
3. DISTANCE FROM BOTTOM OF DEVICE TO FINISH GRADE, FREEZE PROTECTION, AND CLEARANCE FOR TESTING AND REPAIR ARE THE MAJOR CONSIDERATIONS FOR INSTALLATION.



CITY OF TIGARD
OREGON
CAPITAL CONSTRUCTION AND
TRANSPORTATION DIVISION
13125 S.W. HALL BLVD.
TIGARD, OREGON 97223
VOICE: (503) 639-4171
FAX: (503) 684-7297

APPROVED BY:
AGUSTIN P. DUENAS, P.E.
CITY ENGINEER
JULY 2009
APPROVAL DATE

**DOUBLE CHECK
ASSEMBLY**

NO SCALE

DWG. NO.

530